

ADDENDUM NO. 2

TO: ALL PLAN HOLDERS

RE: City of Queen City, Texas-Earthwork and Drainage Improvements

ADDENDUM DATE: October 11, 2023

BID DATE: October 26, 2023 – 2 p.m.

The Plans, Specifications and Contract Documents for the above referenced project are hereby modified as follows:


1. **Site Grading:** The following earthwork estimates are provided for general purposes: The estimated amount of Cut for the site is 8,559 Cubic Yards. Per the Grading Plan the estimated amount of Fill is 7,511 Cubic Yards.

Excess materials shall be placed onsite where tie-in slopes are necessary or in areas where general fill may be placed as allowed by the City / Engineer. Excess materials will not be stockpiled onsite. Each bidder shall review quantities prior to submitting a Lump Sum cost as noted in Bid Item #1 for earthwork.

2. **Bid Form:** Bid Item #7 has been added to include a construction entrance/exit. A detail is included of this scope. The contractor shall keep the existing asphalt street clean of sediment during construction by sweeping or other approved methods.

ADDENDUM NO.2 ISSUED BY:

A.L. FRANKS ENGINEERING

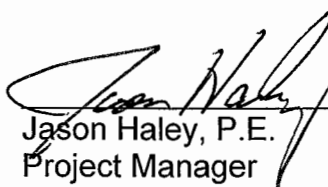

Jason Haley, P.E.
Project Manager

Earthwork and Drainage Improvements – Business Park


Queen City EDC

BID PROPOSAL

<u>ITEM</u>	<u>QTY/UNIT</u>	<u>DESCRIPTION</u>	<u>UNIT PRICE</u>	<u>TOTAL PRICE</u>
1.	1 L.S.	Perform Excavation and Embankment of onsite soils Including all labor, equipment, layout, and compaction In accordance with the plans and specifications for the Lump Sum price of _____ Dollars and _____ Cents/L.S. \$ _____ \$ _____		
2.	1 L.S.	Perform stripping of topsoil (4" depth), stockpile of material, And placement of materials onsite following grading operations, To include all labor, material, and equipment in accordance With the plans and specifications for the lump sum price of _____ Dollars and _____ Cents/L.S. \$ _____ \$ _____		

BID PROPOSAL
(Cont'd)


<u>ITEM</u>	<u>QTY/UNIT</u>	<u>DESCRIPTION</u>	<u>UNIT PRICE</u>	<u>TOTAL PRICE</u>
3.	2,410 L.F.	Provide and Install silt fencing surrounding the work area including all labor, materials, And procedures per the plans and specifications for the unit price of _____ Dollars and _____ Cents/LF	\$ _____	\$ _____
4.	46 LF	Provide and Install 18" dual wall HDPE Pipe with crushed stone backfill as required within street construction including excavation, compaction, Labor, materials, and equipment per the plans And specifications for the unit price of _____ Dollars and _____ Cents/LF	\$ _____	\$ _____

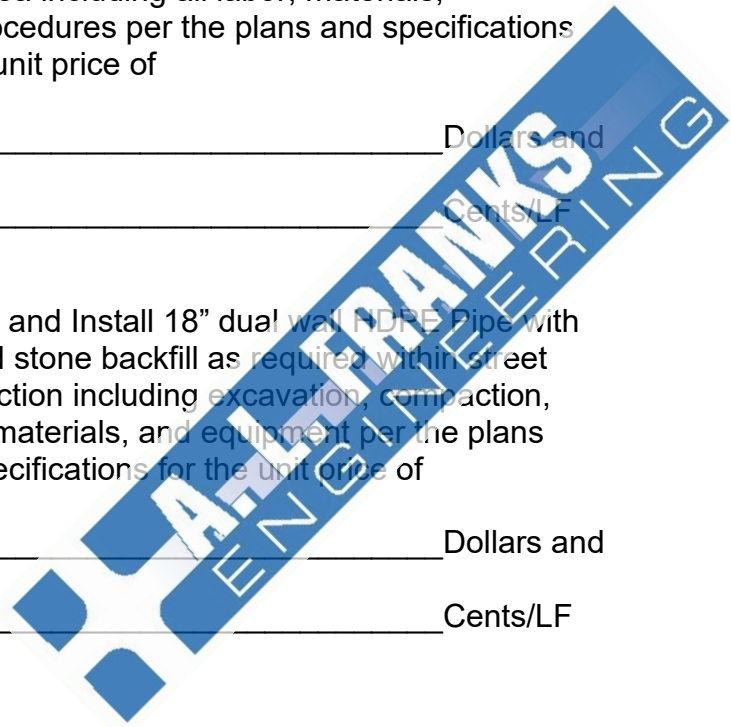

BID PROPOSAL
(Cont'd)

<u>ITEM</u>	<u>QTY/UNIT</u>	<u>DESCRIPTION</u>	<u>UNIT PRICE</u>	<u>TOTAL PRICE</u>
5.	1 EA	Provide and Install 4'x4' concrete 'Y' Inlet including excavation, compaction, Labor, materials, and equipment per the plans And specifications for the unit price of _____ Dollars and _____ Cents/EA	\$ _____	\$ _____
6.	1 LS	Provide and Install seeding of finalized graded area including all materials, labor, and equipment per the plans And specifications for the lumps sum price of _____ Dollars and _____ Cents/LS	\$ _____	\$ _____
7.	LS	Provide and Install Construction Entrance at dead end of existing street to include fabric, stone (14-ft width, 20-ft Length) as shown in BMP Detail to include all materials, labor, and equipment per the plans and specifications for the lumps sum price of _____ Dollars and _____ Cents/LS	\$ _____	\$ _____
TOTAL BASE BID			\$ _____	

Notes: Construction Staking shall be performed by the Contractor.

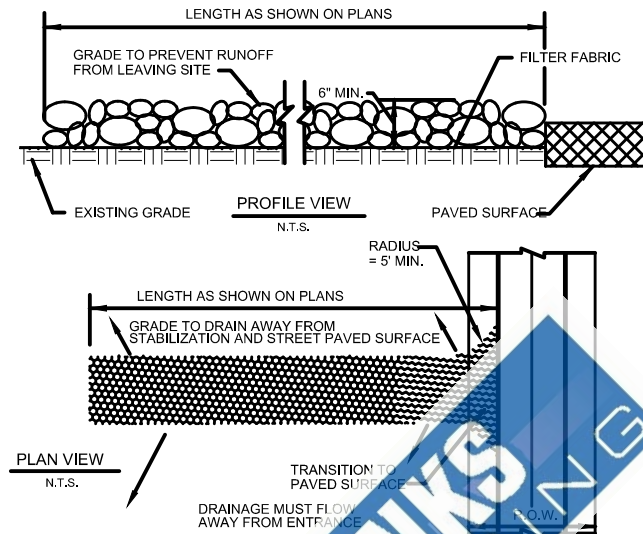

STABILIZED CONSTRUCTION ENTRANCE GENERAL NOTES

1. STONE SHALL BE 3 TO 5 INCH DIAMETER COARSE AGGREGATE.
2. LENGTH SHALL BE AS SPECIFIED IN THE SWPPP.
3. THE THICKNESS SHALL NOT BE LESS THAN 12 INCHES.
4. THE WIDTH SHALL BE NO LESS THAN THE FULL WIDTH OF ALL POINTS OF INGRESS OR EGRESS.
5. WHEN NECESSARY, VEHICLES SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO A PUBLIC ROADWAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE WITH DRAINAGE FLOWING AWAY FROM BOTH THE STREET AND THE STABILIZED ENTRANCE. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH OR WATERCOURSE USING APPROVED METHODS.
6. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PAVED SURFACES. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND. ALL SEDIMENT SPILLED, DROPPED, WASHED, OR TRACKED ONTO PAVED SURFACES MUST BE REMOVED IMMEDIATELY.
7. THE ENTRANCE MUST BE PROPERLY GRADED OR INCORPORATE A DRAINAGE SWALE TO PREVENT RUNOFF FROM LEAVING THE CONSTRUCTION SITE.
8. PREVENT SHORTCUTTING OF THE FULL LENGTH OF THE CONSTRUCTION ENTRANCE BY INSTALLING BARRIERS AS NECESSARY.
9. INSPECTION SHALL BE AS SPECIFIED IN THE SWPPP.

CONSTRUCTION ENTRANCE

N.T.S.



118 East Broad Street
 Texarkana, Arkansas 71854
 Phone (870) 216-1906
 Fax (870) 216-1907

BEST MANAGEMENT PRACTICES

Job No.: SWPPP

Scale: AS_SHOWN

Date: 11/30/2016

Sheet 2